


IN CASE OF FIRE, PULL FIRE ALARM SIGN

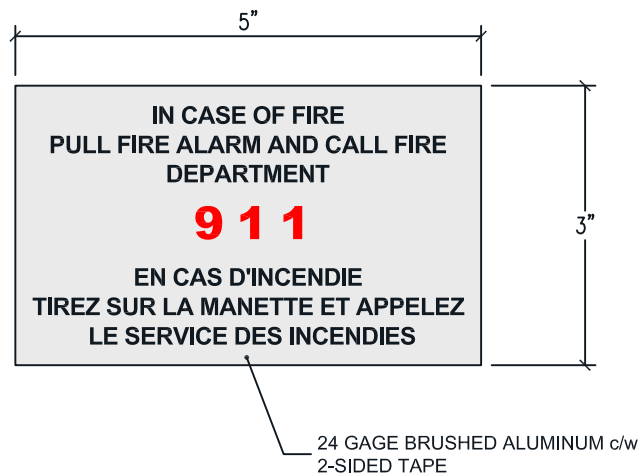

ONTARIO BUILDING CODE

SIGNALS TO FIRE DEPARTMENT

(5) Where a single stage fire alarm system is installed in a building that is not sprinklered, and Sentence (1) does not apply, a legible notice, that is not easily removed, shall be affixed to the wall near each manual pull station stating,