


EVACUATION SIGN - HOTEL GUEST SUITE (Acrylic Sign Holder)

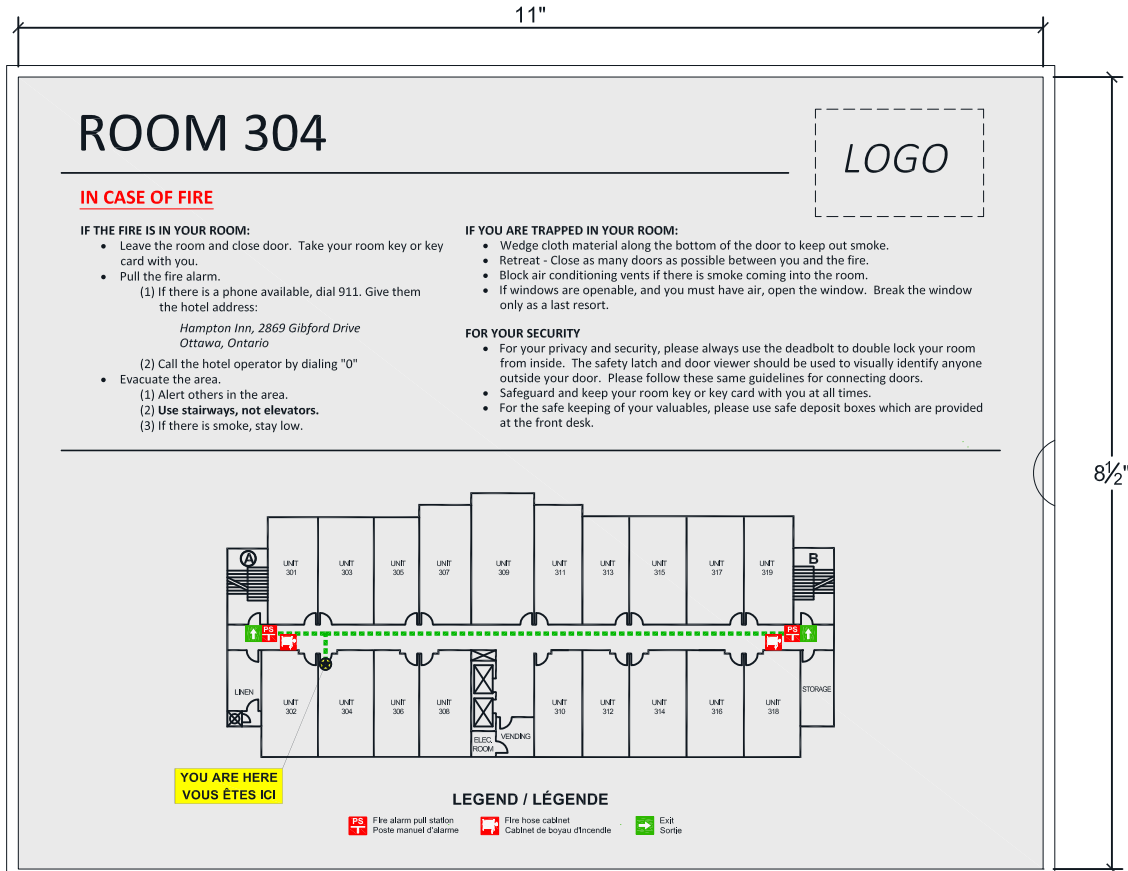

ACRYLIC SIGN HOLDER WITH
8.5x11" PAPER INSERT

**ONTARIO REGULATION 213/07
FIRE PROTECTION AND PREVENTION ACT, 1997**

2.8.2.5. POSTING FIRE EMERGENCY PROCEDURES

- (1) At least one copy of the fire emergency procedures shall be prominently posted and maintained on each floor area.
- (2) In addition to Sentence (1), in a hotel establishment
 - a) one copy of the approved fire safety plan shall be posted in the main reception area, and
 - b) a copy of the emergency procedures, location of exits and the fire safety rules shall be posted on the inside of the egress doors of each guest suite.